



TYPICAL SURFACE MOUNTED TRI INSTALLATION DETAIL "J"
(NEAR EXISTING SURFACE MOUNTED TENANT F.A. PANEL)
N.T.S.

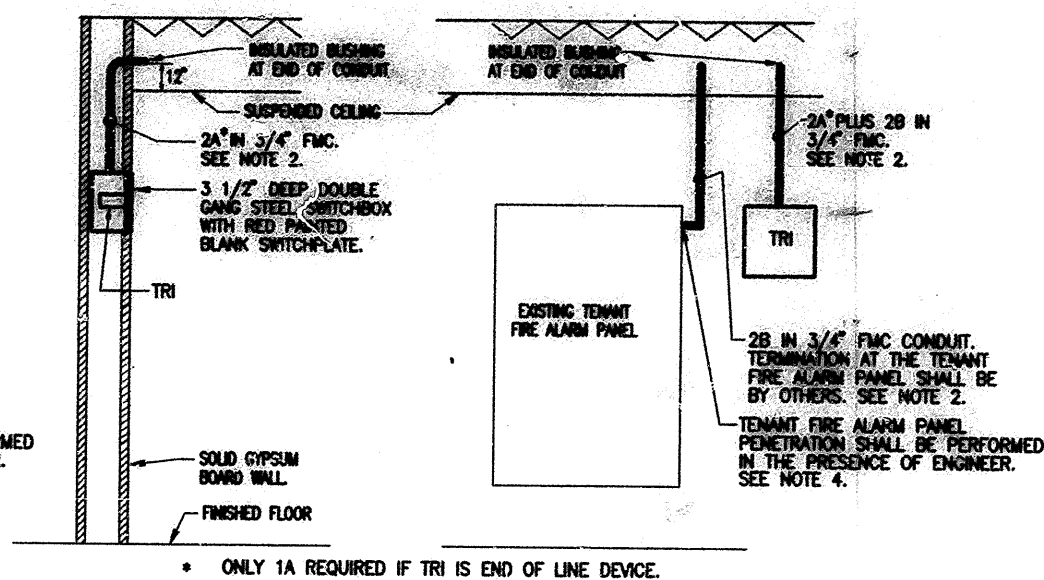

TYPICAL FLUSH MOUNTED TRI INSTALLATION DETAIL "K"
(NEAR EXISTING FLUSH MOUNTED TENANT F.A. PANEL)
N.T.S.

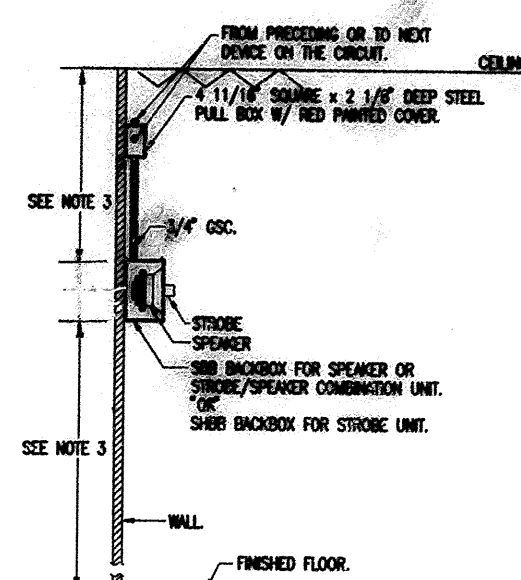

TYPICAL WALL MOUNTED (FOR MER TYPE AREA) STROBE/SPEAKER INSTALLATION DETAIL "L"
N.T.S.

- NOTES:**
1. FOR ABBREVIATIONS, TERMINATION & CIRCUIT LEGEND, GENERAL NOTES AND LEGEND/SPECIFICATION, SEE DWG E-02-1.
 2. FOR WIRING DIAGRAMS, SEE DWG E-02-5 AND E-02-6.
 3. CONTRACTOR SHALL INSTALL THE FIRE ALARM DEVICE AT 80" ABOVE FINISHED FLOOR OR 6" BELOW SUSPENDED CEILING, WHICHEVER IS LOWER.
 4. COORDINATE CONDUIT PENETRATIONS OF TENANT FIRE ALARM CONTROL PANEL WITH TENANT FIRE ALARM CONTROL PANEL SERVICE VENDOR.

Sheet 6 of 6



DESIGNED BY: *[Signature]*

CHECKED BY: *[Signature]*



DATE: 7/7/99

AS-BID


Approved: *[Signature]*

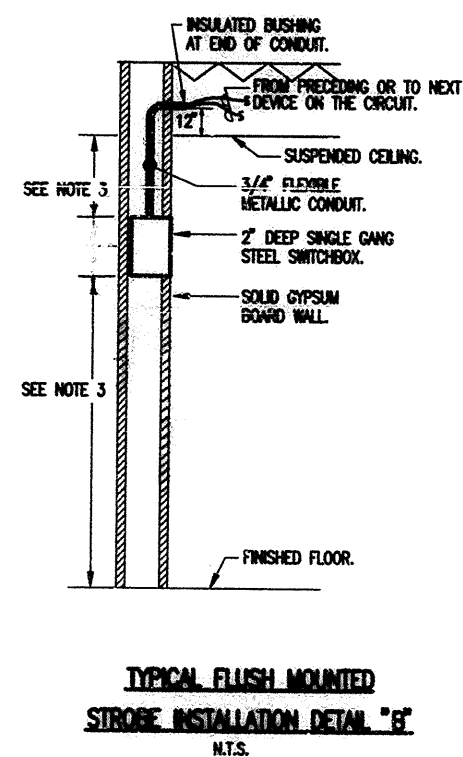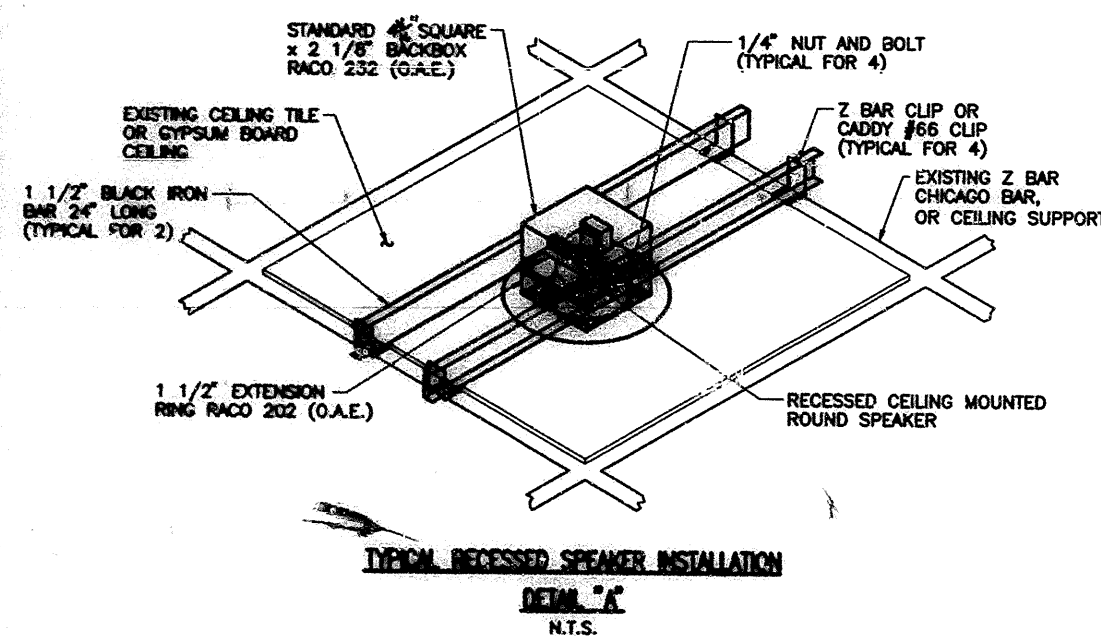

TYPICAL FLUSH MOUNTED STROBE INSTALLATION DETAIL "N"
N.T.S.

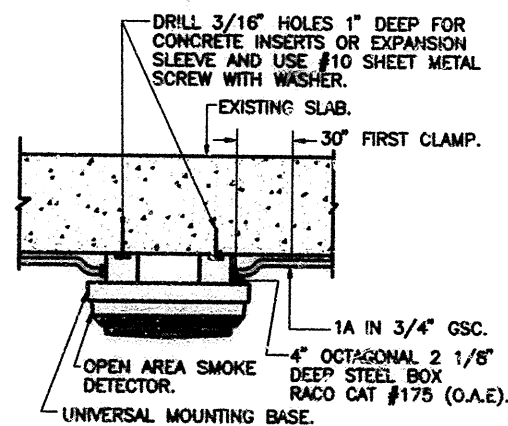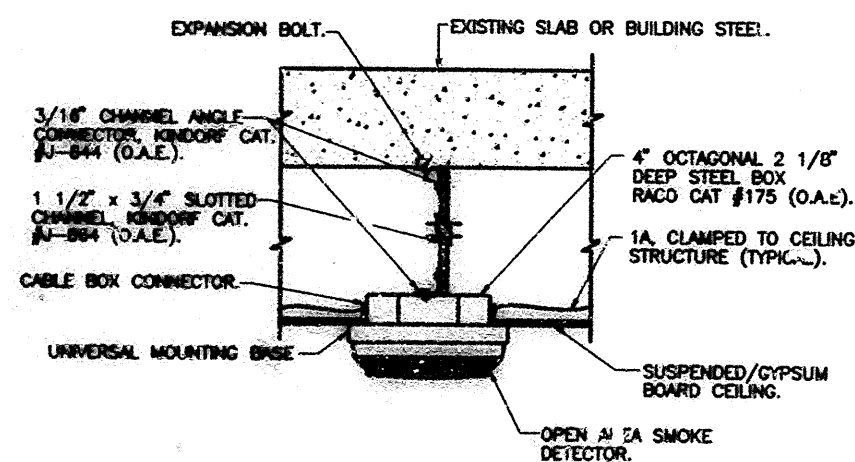

SMOKE DETECTOR INSTALLATION DETAIL "Q"
(FOR OPEN CEILING)
N.T.S.

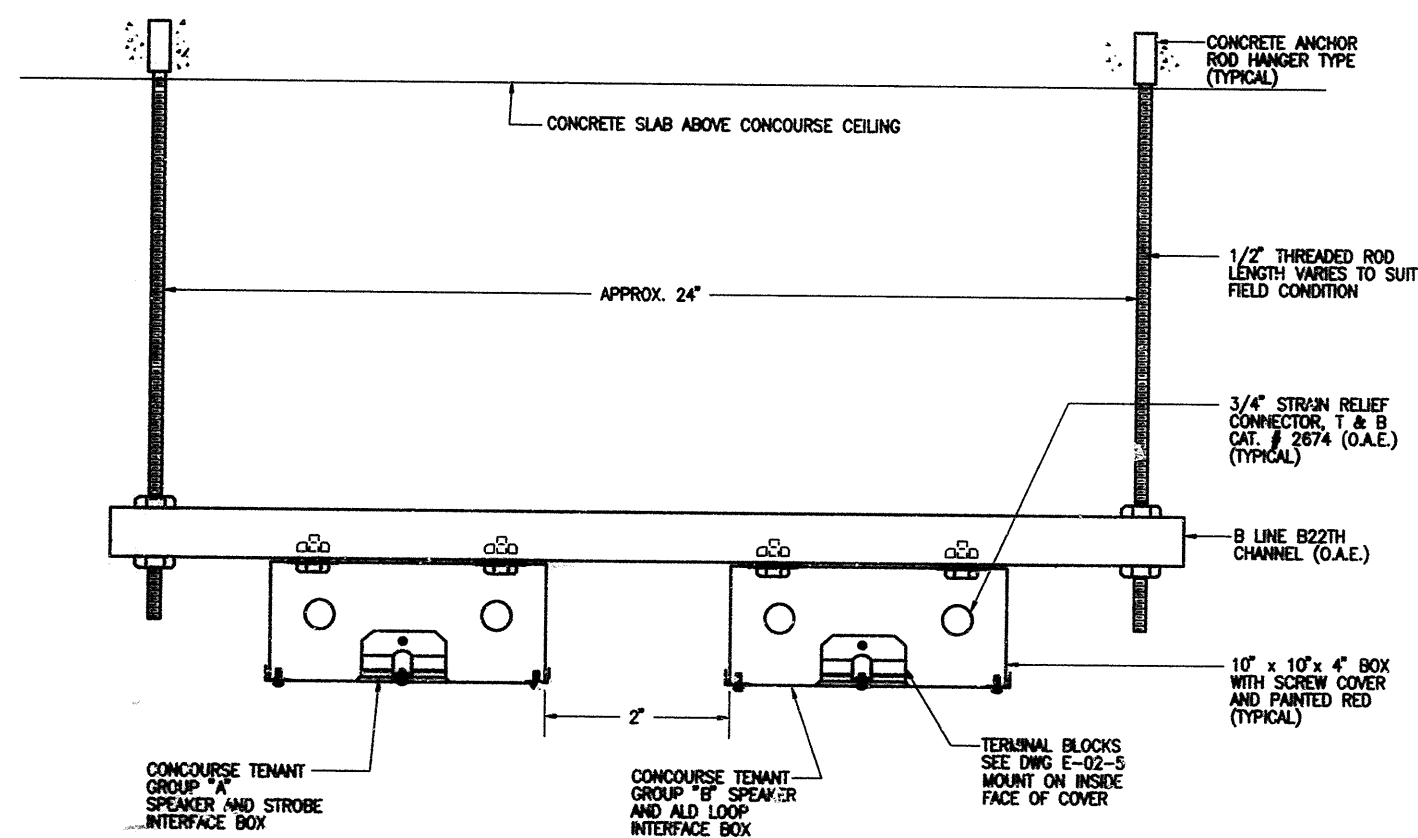

No.	Date	Revision	Approved
1	7/7/99	AS-BID	<i>[Signature]</i>
ENGINEERING DEPARTMENT			
WORLD TRADE CENTER			
ELECTRICAL			
Title			
FIRE ALARM SYSTEM			
PHASE III			
5 WTC PLAZA LEVEL DEVICE INSTALLATION DETAILS			
This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.			
FELDSTEIN B. FAROUKI A.S.			
Designed by Drawn by Checked by			
MAY 31, 1999			
Date			
WTC-861.372 E-02-4			
Contract Number Drawing Number			